



# Downspout Dispersion Trench

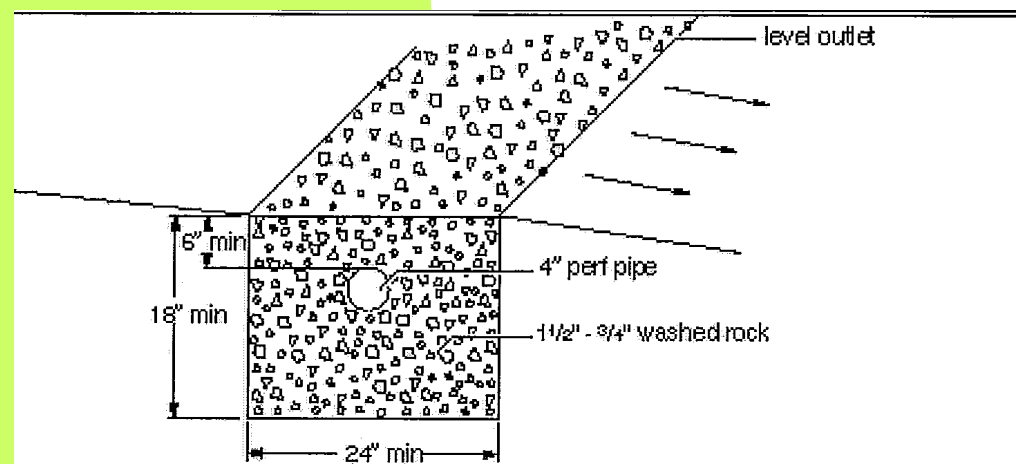

**TRENCH X-SECTION**  
NTS

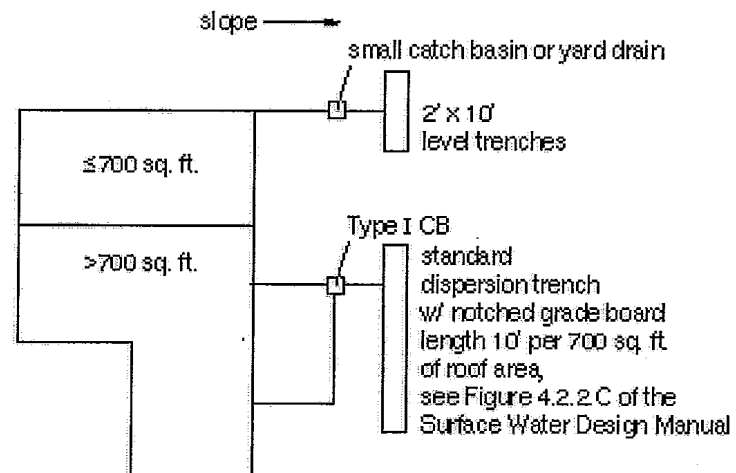

**PLAN VIEW OF ROOF**  
NTS

## Design Basics

If you have a septic system, the discharge point must be below the drainfield

Must have 25' of vegetation between the trench outlet and the property line or road

Must have 10' of trench length for every 700 sf of roof area

The system discharge must not be placed near a landslide hazard area or on or above a slope greater than 20% without a geotechnical engineer's evaluation