


Perforated Stub Out Connections

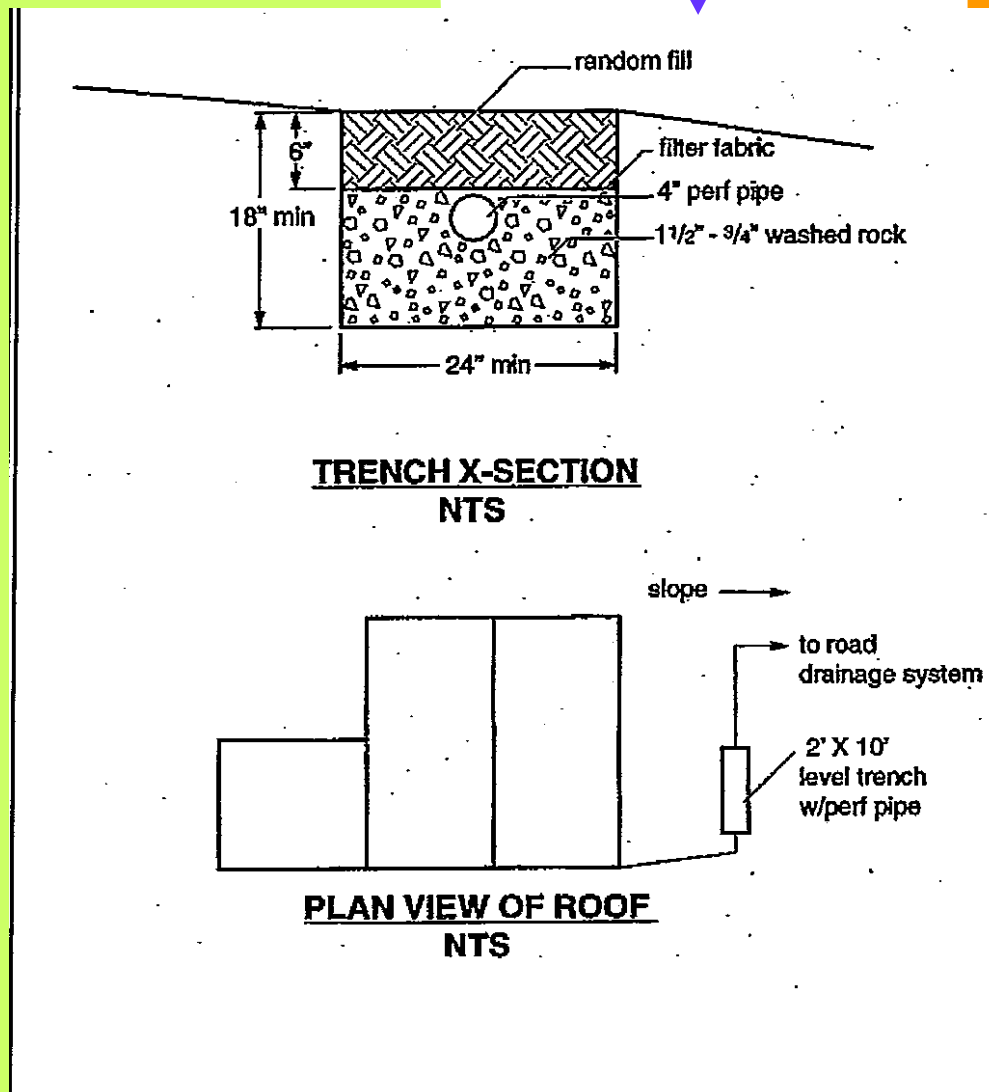

Design Basics

If you have a septic system, the discharge point must be below the drainfield

Must have 50' of vegetation between the splashblock outlet and the property line or road

No erosion or flooding of downstream properties may result

Must have 10' of perforated pipe per 5000 sf of roof area. Trench must be level.

The system discharge must not be placed near a landslide hazard area or on or above a slope greater than 20% without a geotechnical engineer's evaluation